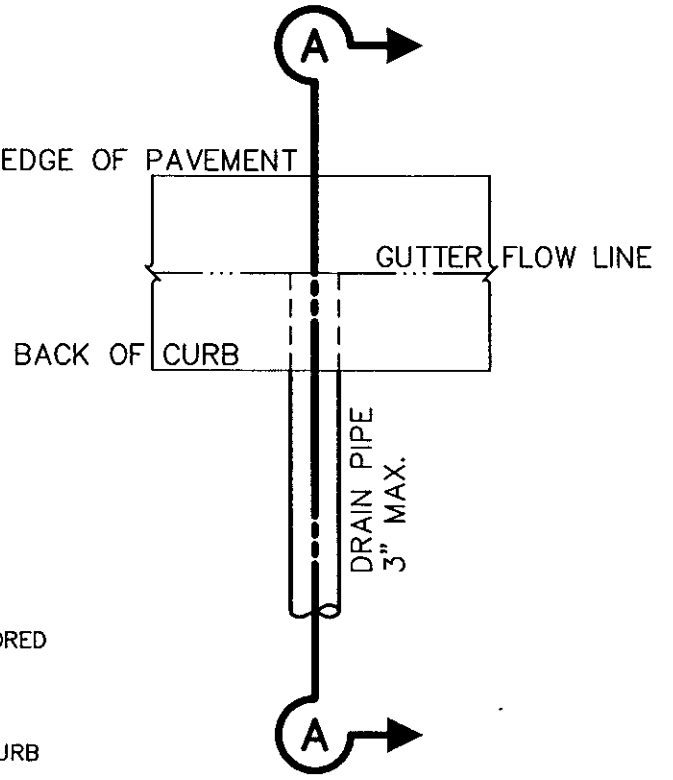

NOTES:

1. CONCRETE CURB SHALL BE CORED TO PROVIDE A MAXIMUM DRAIN PIPE DIAMETER OF 3".
2. CONTRACTOR SHALL GROUT CURB ALL AROUND DRAIN PIPE.
3. DRAIN PIPE SHALL EMPTY AT THE GUTTER FLOWLINE.
4. DRAIN PIPE SHALL BE CONTOURED TO THE FACE OF CURB.

PLAN VIEW

NOT TO SCALE

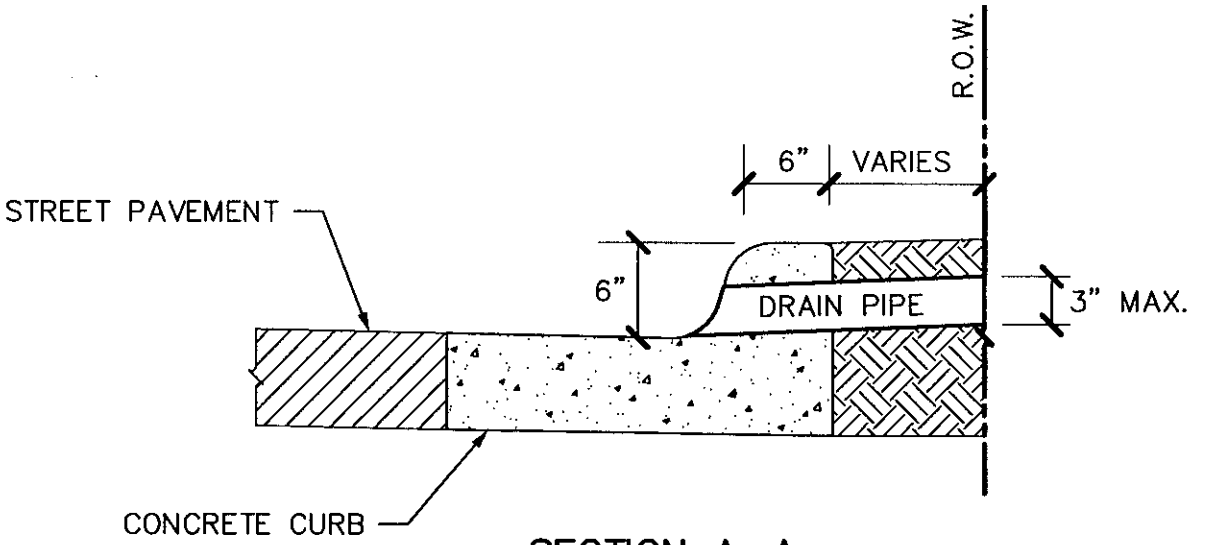

SECTION A–A

NOT TO SCALE

MANSFIELD TEXAS	RESIDENTIAL DRAIN PIPES	DATE JAN 2002
		DR–4